

LOCATION: DATE: PROJECT: TYPE: CATALOG #:

LIGHTOWL® PASSIVE INFRARED WALL MOUNT SENSOR

CEILING AND WALL MOUNT OCCUPANCY SENSORS

FEATURES

- IntelliDAPT® self-adaptive technology-no manual adjustment required
- All-digital passive infrared (PIR) sensor
- · Non-volatile memory for sensor settings
- 1,600 square-foot coverage area
- · Optional relay and photocell control
- · Low voltage device: 24 VDC
- · 5 year warranty











RELATED PRODUCTS

- 8 Occupancy Sensor Accessories
- Universal Voltage Power Packs
- Heavy Duty Universal Voltage Power Packs

8 MP347A Power Pack

8 MPSHD Pack

SPECIFICATIONS

CONSTRUCTION

- · Casing Rugged, high-impact, injectionmolded plastic KJB ABS Cycolac (UL-945VA) flame class rating, UV inhibitors
- · Color-coded leads are 6" long (152.4mm)
- 5.0 oz. (142g)
- Off-white
- · Red-Infrared motion
- · Dual-element pyrometer and 12-element cylindrical rugged lens

MOUNTING

- · Mounting base provided
- · LOIRWV Max mounting height: 12ft.
- · LOIRHB Max mounting height: 30ft.

ELECTRICAL

- · 24VDC, 33 mA (uses UVPP and MP-Series power pack-not included)
- 24VDC active high-logic control signal with short circuit protection and optional dry contact

OPERATION

- IntelliDAPT
 - · Auto reset from test setting
 - · Self-adjusting timer
 - · Self-adjusting passive infrared and acoustic thresholds
 - · Automatic false-ON/false-OFF corrections
- · Coverage
 - · LOIRWV (Wide View): 1,600 square feet (487.68 square meters)
 - LOIRHB (High Bay): 120 linear feet
- · Timer Settings
 - · Automatic mode: 8-30 minutes (selfadjusts based on occupancy)
 - · Test mode: 8 seconds (for an easy check at installation)
- · RP Option
 - · Relay and photocell included
 - Relay: N/O + N/C contacts; SPDT; 500 mA rated @ 24 VDC; three-wire isolated relay

OPERATION (CONTINUED)

- · Photocell: adjustable natural-light override ranges from 0 to 100 footcandles (0-1,000 lux)
- · Factory set at 3,000 lux (disable photocell)

OPERATING ENVIRONMENT

- · Indoor use only
- Operating temperature: 32° to 104°F (0° to 40°C)
- · Relative humidity (non-condensing): 0% to 95%

CERTIFICATIONS

· Listed UL and cUL

WARRANTY

- 5 year warranty
- · See HLI Standard Warranty for additional information

ORDERING GUIDE

							Example: LOIRWV	
CATALOG #								
				-				
LO			-	-				
Series	Technology				Relay/P	Photocell Option		
LO	IRWV	Passive Infrared Wide View			RP	Relay Photocell		
	IRHB	Passive Infrared High Bay			Blank	No Relay Photoc	ell	





DATE: LOCATION:


TYPE: PROJECT:

CATALOG #:

LIGHTOWL® PASSIVE INFRARED WALL MOUNT SENSOR


CEILING AND WALL MOUNT OCCUPANCY SENSORS

DIMENSIONS



ADDITIONAL INFORMATION

Coverage Patterns




20'-0" Minor Motion Coverage (6.10–0m)

LOIRWV-Coverage Range (Top View)

LOIRWV–Coverage Range (Side View)

10'-0" Mounting Height (3.05-0m)



LOIRHB - Coverage Range (Top View)

All product and company names, logos and product identifiers are trademarks " or registered trademarks of Hubbell Lighting, Inc. or their respective owners. Use of them does not necessarily imply any affiliation with or endorsement by such respective owners.



DATE: LOCATION:

TYPE: PROJECT:


CATALOG #:

LIGHTOWL® PASSIVE INFRARED WALL MOUNT SENSOR

CEILING AND WALL MOUNT OCCUPANCY SENSORS


ADDITIONAL INFORMATION (CONTINUED)

Wiring Diagrams

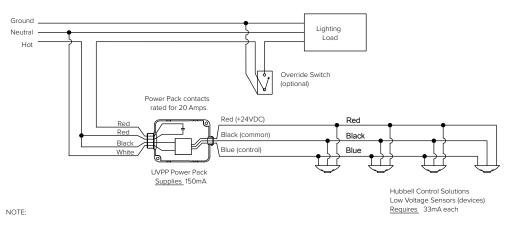

 DO NOT attempt to power more than 4 devices, be it sensors or slave packs, from a single power pack.

1 Circuit with up to 4 Sensors and UVPP

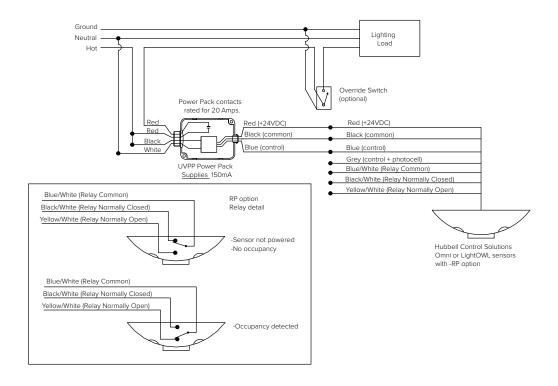

1 Circuit with up to 4 Sensors and UVPP





DATE: LOCATION:

TYPE: PROJECT:


CATALOG #:

LIGHTOWL® PASSIVE INFRARED WALL MOUNT SENSOR

CEILING AND WALL MOUNT OCCUPANCY SENSORS

ADDITIONAL INFORMATION (CONTINUED)

Wiring Diagrams

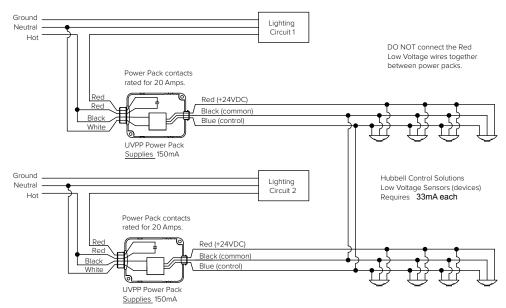

- NOTES:
- 1. Lighting load turns on when at least one sensor detects motion
- DO NOT attempt to power more than 4 devices, be it sensors or slave packs, from a single power pack
- 3. No more than 4 power packs should be connected in this way

1 Circuit with RP Option Wiring

